
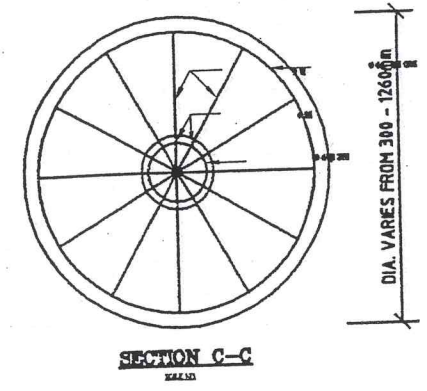
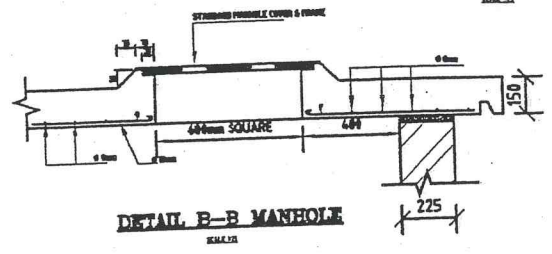



SECTION A-A
SCALE: 1/10

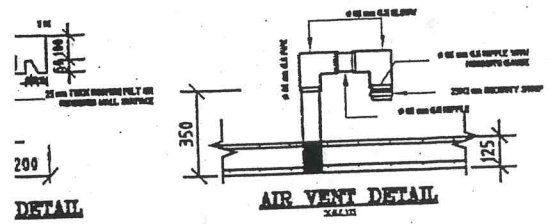

REINFORCEMENT:
 TOP STEEL: 16 mm @ 125 c/c
 BOTTOM STEEL: 16 mm @ 125 c/c
 WALL STEEL: 16 mm @ 125 c/c
 RING STEEL: 16 mm @ 125 c/c
 RAFTER STEEL: 16 mm @ 125 c/c
 FLOOR STEEL: 16 mm @ 125 c/c
 WALL STEEL: 16 mm @ 125 c/c
 RING STEEL: 16 mm @ 125 c/c
 RAFTER STEEL: 16 mm @ 125 c/c
 FLOOR STEEL: 16 mm @ 125 c/c

-12 No.
 i = $\phi 6 @ 250$ CRS
 CONCRETE COVER = 30mm
 $\Omega = 30^\circ$
 $r = 108$ mm
 R150

MINISTRY OF WATER & IRRIGATION - MAJI HOUSE			
225M³ MASONRY STORAGE TANK OR SUCTION SUMP			
			SHEET 4 OF 6
DRAWN	S. OWIND	JULY 1979	SCALE: AS SHOWN
DIGITIZED	ALUCHIO M.F	JUNE 2009	DRG. NO.
CHECKED	ENG. B.I KASABULI	JUNE 2009	M.W.I
APPROVED	D.W.S	JUNE 2009	013-TYPE-072